


STRUCTURAL TABLES

ALL INTERIOR AND EXTERIOR LINTELS TO BE 2-38 x 235 (2-2" x 10") WITH POST TYPE P3 EACH END UNLESS NOTED OTHERWISE.

ALL POSTS TO BE CONTINUOUS TO TOP OF FOUNDATION WALL OR CONCRETE PAD / FOOTING. PROVIDE SOLID BLOCKING BETWEEN POSTS IN FLOOR SPACE.

MAX. SPAN	LINTEL	VERT. LEG	HORIZ. LEG	THICKNESS
230 (8'-2")	90 (3 1/2")	90 (3 1/2")	8 (1/4")	8 (1/4")
248 (8'-2")	120 (4 7/8")	90 (3 1/2")	8 (5/16")	8 (5/16")
324 (10'-8")	125 (4 7/8")	90 (3 1/2")	10 (5/8")	10 (5/8")

- MASONRY VENEER WALLS**
- MIN. 90mm (3 5/8") THICK UP TO 7315 (24'-0") MAX. HIGH.
 - TIES TO BE GALVANIZED, CORROSION RESISTANT CORRUGATED 7/8mm x 22mm (22 ga x 7/8") WIDE METAL STRAPPED TO FOUNDATION WALLS. SPACING SHALL BE 1200mm (48") HORIZONTALLY & 600mm (24") VERTICALLY. FASTEN TO STUDS THROUGH EXTERIOR SHEATHING WITH MIN. 6mm (1/2") DIA. NAIL HEAD. PENETRATE NOT LESS THAN 30mm (1 1/4") IN STUD. DISTANCE OF WALL FROM THE BEAD NOT MORE THAN 6mm (1/4") FROM THE BEAD. PROVIDE SOLID BLOCKING BETWEEN THE TIES MUST NOT BE COMPRESSED.
 - PROVIDE MIN. 25mm (1") AIR SPACE BETWEEN VENEER AND WALL SHEATHING.
 - DRAIN BOTTOM OF SPACE WITH HOLES AT 600 o.c. (2'-0") IN STARTER COURSE MIN. 150mm (6") ABOVE FIN. GRADE. 10mm (3/8") DIA. HOLES.
 - PROVIDE 6 MIL POLYETHYLENE FLASHING UNDER STARTER COURSE UNDER WEEP HOLES AND 150mm (6") UP WALL UNDER SHEATHING PAPER.
 - MAX. CORREL OVER FOUNDATION WALL 13mm (1/2") FOR 90mm (3 5/8") BRICK.

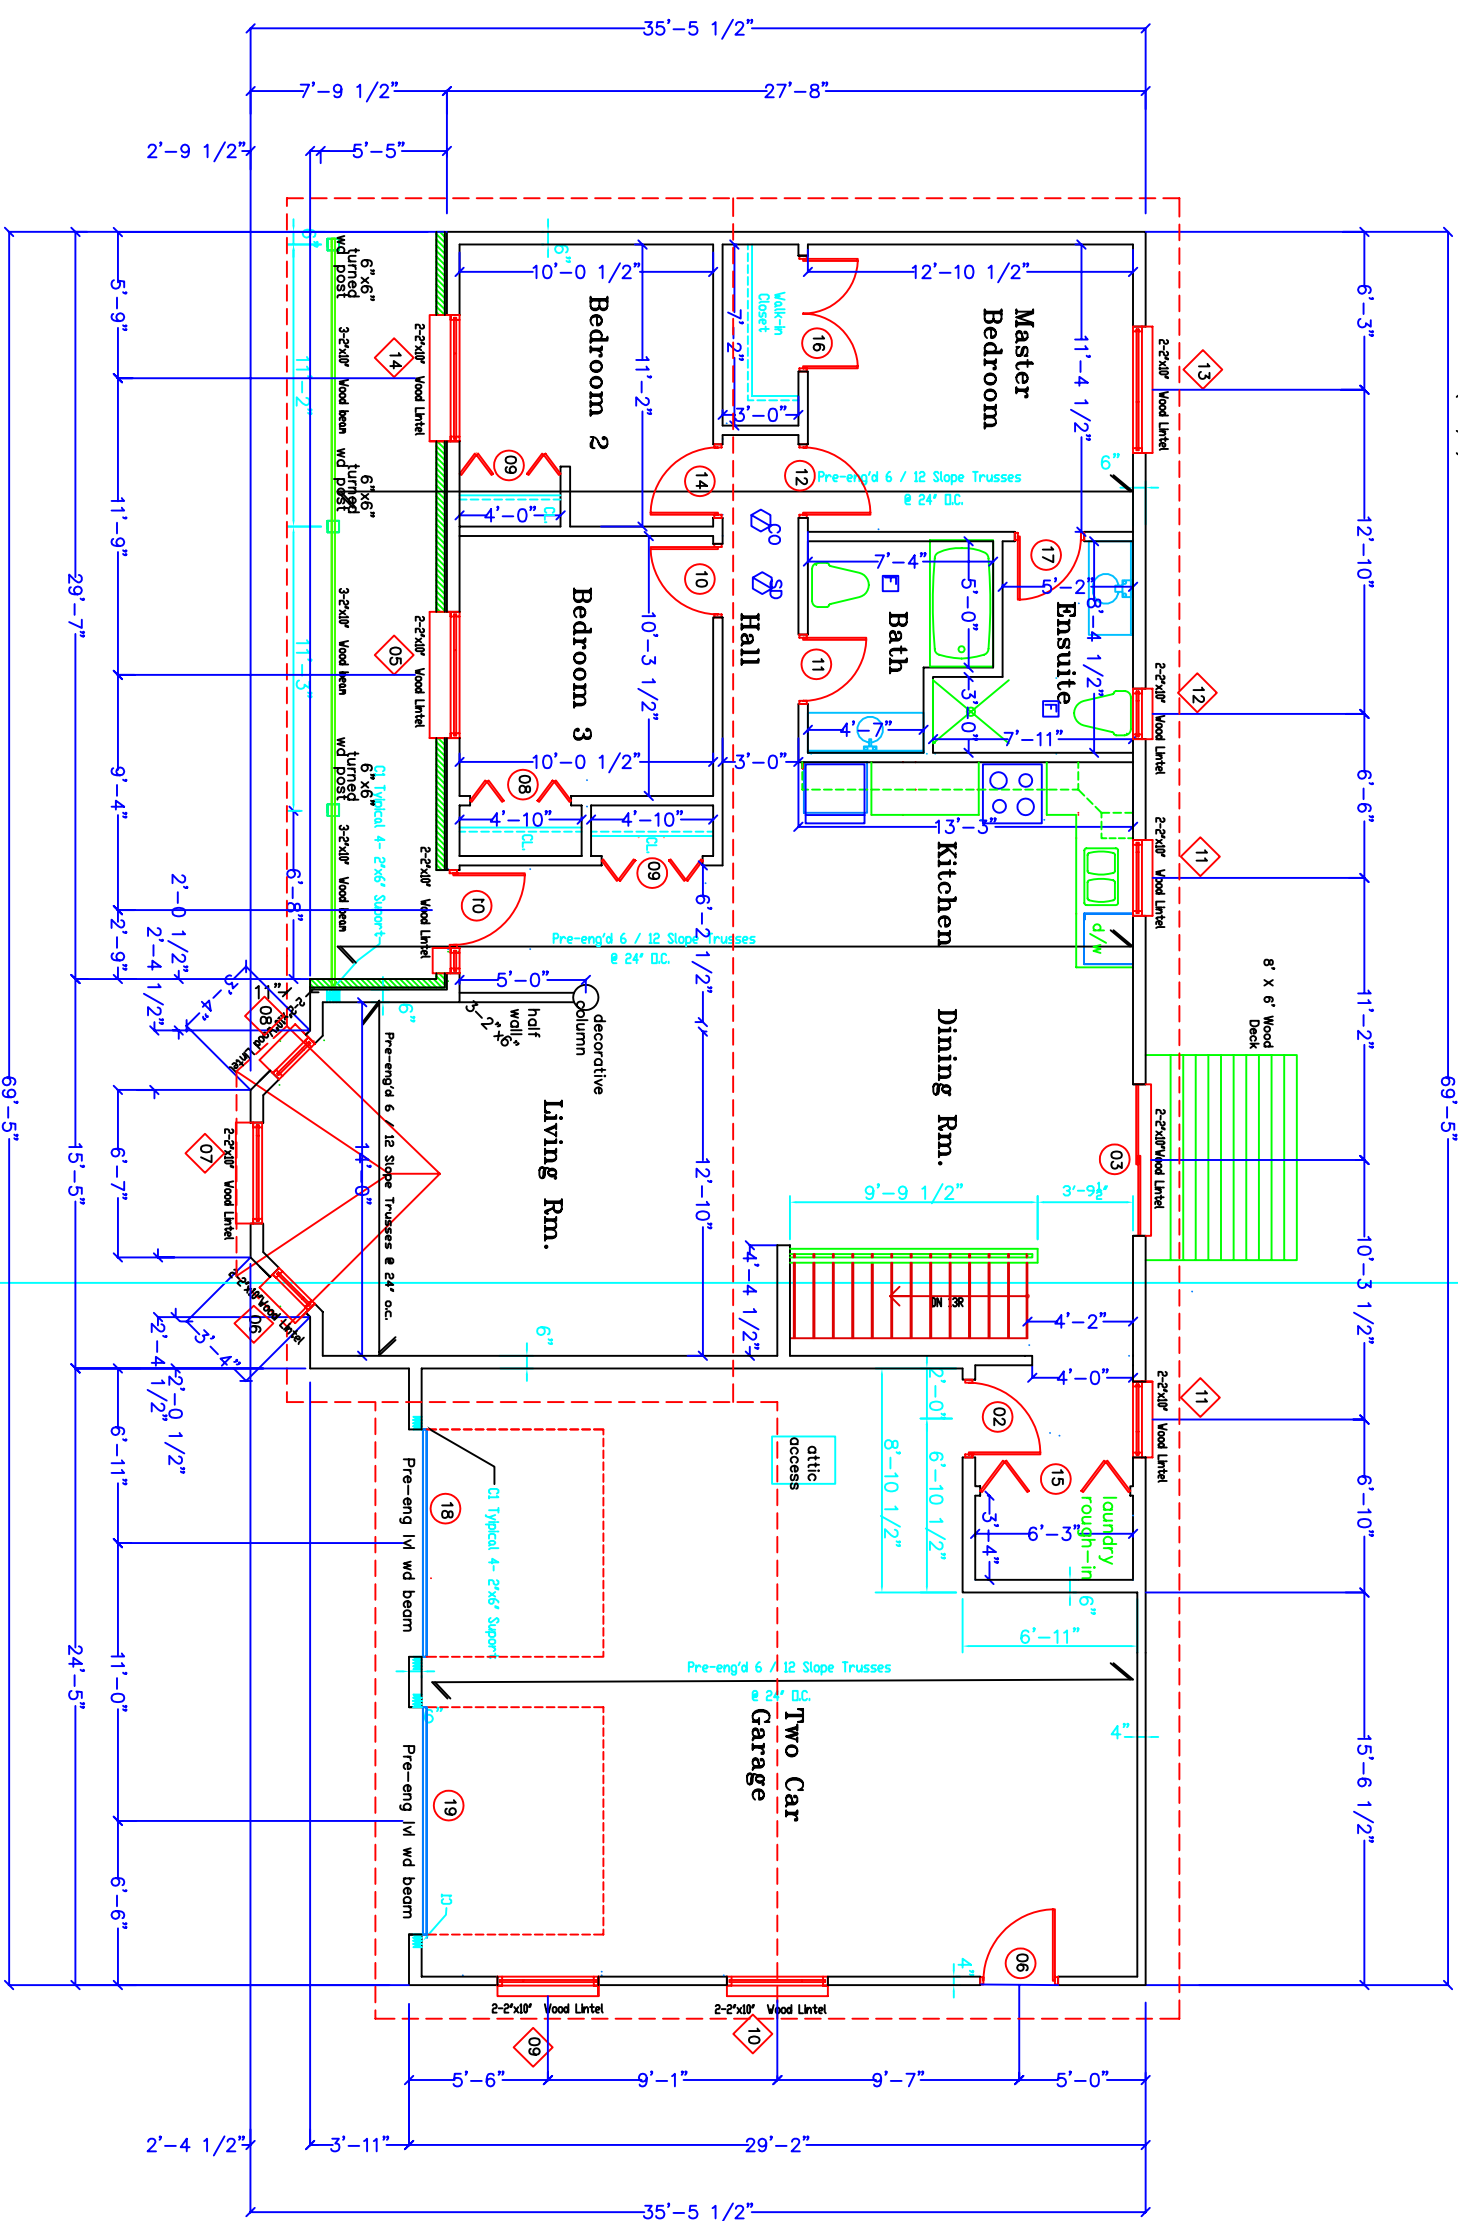

- LEGEND:**
- INTERCONNECTED A/C SMOKE DETECTOR
 - CARBON MONOXIDE DETECTOR
 - BATH EXHAUST FAN

REVISIONS:

NO.	REVISION	DATE

Construction Notes:

- All construction shall conform to the Ontario Building Code.
- All doors and windows sizes shall be confirmed & approved by owner or contractor prior to construction.
- Contractor shall verify all conditions and dimensions prior to construction and be solely responsible for any changes or dimensional differences.
- Verify all dimensions on site.
- All dimensions are taken from the exterior face of concrete.
- Any substitution of materials or spans shall conform to the Ontario Building Code.
- Install floor joists or wood blocking under non-loadbearing walls that run parallel to floor joist.
- Provide solid wood blocking under all point loads.
- Concrete foundations walls and footings shall have a compressive strength of 15MPa after 28 days.
- Unreinforced concrete garage and carport floors and all flat work shall have a compressive strength of 32 MPa after 28 days
- Stair dimensions shall conform to D.B.C. 9.8.3(K) & Table 9.8.3.I
- Max. Rise = 7 7/8"
- Min. Rise = 4"
- Max. Run = 14"
- Min. Run = 8"
- Max. Tread Depth = 14"
- Min. Tread Depth = 9"
- Guardrails for all stairs and decks shall conform to D.B.C. 9.8 & S5-7
- Stairwell headroom in a dwelling unit shall be min. 6'-5" measured vertically and shall conform to D.B.C. 9.8.3.4(K)
- Carbon Monoxide detectors within dwelling units shall conform to D.B.C. 9.3.4.2(K)(2)(a),(b),(2)(3).
- All smoke alarms within dwelling units shall conform to D.B.C. 9.10.18.4(K)
- All Electrical equipment & facilities within a dwelling unit shall conform to D.B.C. 9.3.4.12(K).

Ruyf Drafting & Design Inc.

 AutoCAD Drafting * Design
 Graphic Architectural Perspectives
 RR2 Mountain, On. KOE 150 613-989-3232

Project: **"The Puddy" Model Home**
 Client: ROBINSON CUSTOM HOMES

Drawing Title: **MAIN FLOOR PLAN**

Scale: 1/8" = 1'-0"	Date: JUNE, 2009
Drawn By: G. RUYF	Drawing No. A2 of 5
Checked By:	
Approved By:	

MAIN FLOOR PLAN
 1402 SQUARE FEET